


- NOTES : 1. IN ORDER TO PREVENT THAT EACH PROTECTOR RESETS AUTOMATICALLY.  
 IT HAS TO BE WIRED THAT THE CIRCUIT IS CLOSED BY MANUAL OPERATION.  
 2. CONTROL CIRCUIT : 1) CURRENT RANGE = 0.2 ~ 1.0 A.  
 2) MUST HAVE DEVICE WHICH PROTECT REVERSING ROTATION OF COMPRESSOR.

SPECIAL NOTE

THE PART SHOULD NOT CONTAIN PROHIBITED SUBSTANCE  
 (Pb,Cd,Hg,Cr+6,PBB,PBDE) AND DETAIL SHOULD COMPLY WITH  
 MITSUBISHI ELECTRIC CHEMICAL SUBSTANCE CONTROL LIST

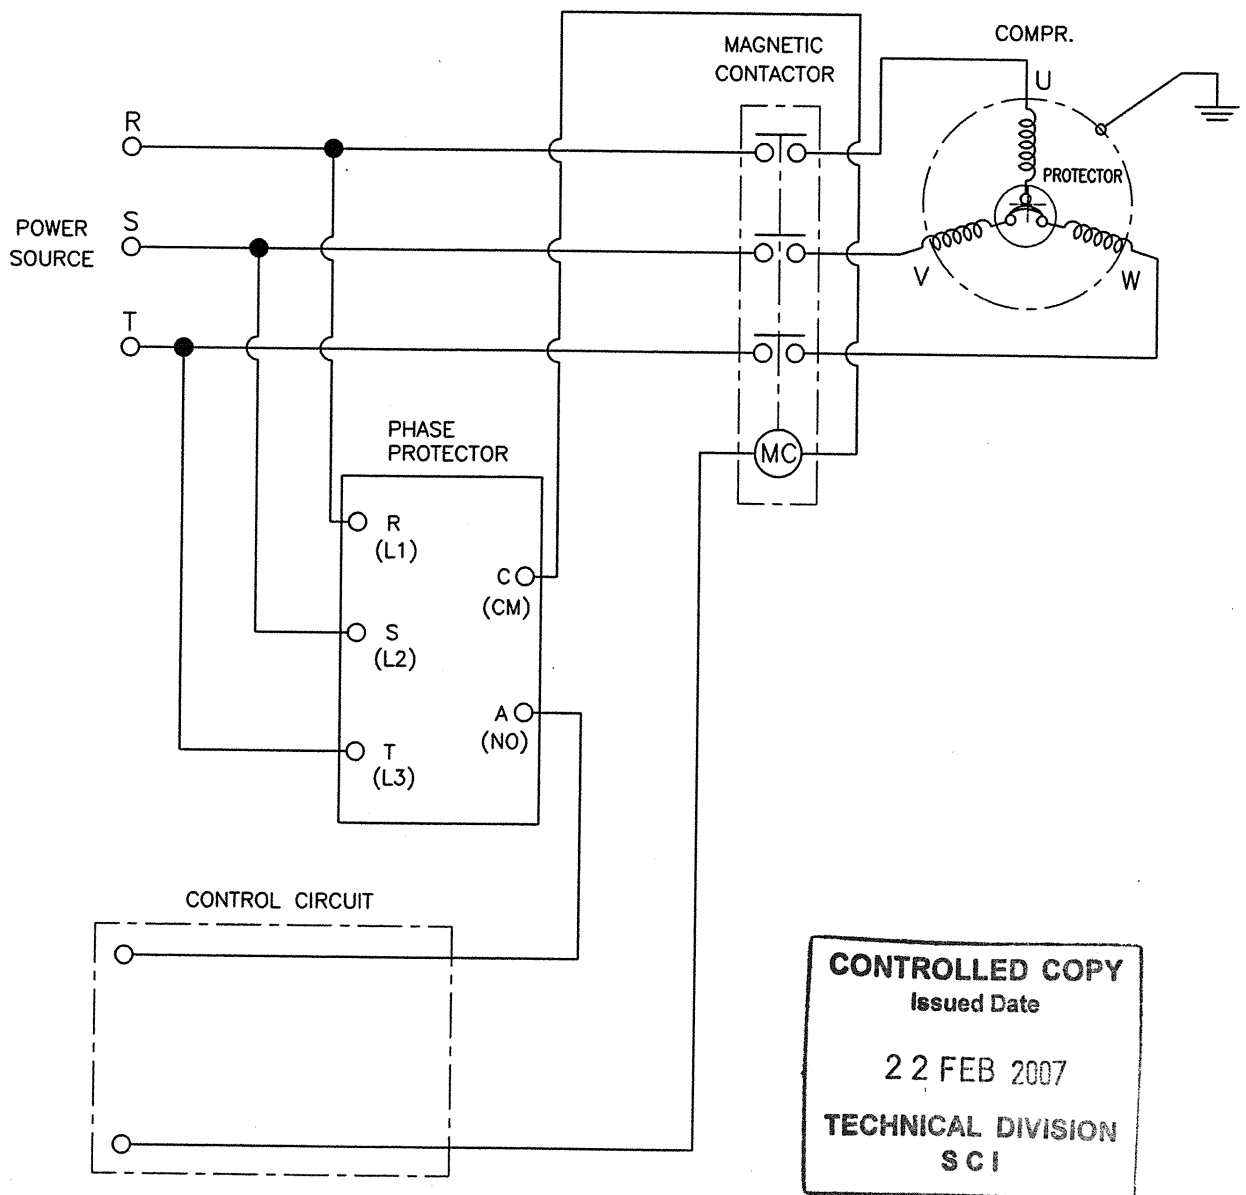

CHANGE  
 [A] (D-2) (L1),(L2)  
 (L3),(CM),(NO)  
 WERE ADDED.  
 I.KORAKOT

SIAM COMPRESSOR INDUSTRY CO.,LTD.			
DIM. IN mm.	DATE	07-02-22	APPROVED
SCALE	DRAWN	K.WILAILAK	<i>[Signature]</i>
	CHECKED	<i>[Signature]</i>	
	DESIGNED	<i>[Signature]</i>	

TITLE	WIRING DIAGRAM	
DWG. No.	SC01D319	